


SAMPLE EROSION AND SEDIMENT CONTROL PLAN FOR INDIVIDUAL LOTS WITH SWALE DRAINAGE



EROSION AND SEDIMENT CONTROL NOTES:

1. WATER RESOURCES STAFF MUST BE CONTACTED 24 HOURS PRIOR TO ANY DEWATERING ACTIVITIES.
2. PERIMETER CONTROL MUST BE SILT FENCE UNLESS OTHERWISE APPROVED BY CITY STAFF.
3. TEMPORARY STOCKPILES CANNOT BE PLACED IN DRAINAGE SWALES, SURFACE WATERS, OR ON PUBLIC STREETS, AND MUST HAVE PERIMETER CONTROL.
4. A MINIMUM OF 6" OF TOPSOIL IN ALL DISTURBED AREAS TO BE ESTABLISHED AS GRASS.
5. ROCK CONSTRUCTION ENTRANCE MUST BE CONSTRUCTED OF 1-2" CLEAN CRUSHED ROCK AT A DEPTH OF 6", MINIMUM OF 20 FEET LONG.
6. EROSION CONTROL BLANKET MUST BE PLACED IN ALL SWALES OR AREAS OF CONCENTRATED FLOW.
7. SLOPES 3:1 OR STEEPER SHALL HAVE EROSION CONTROL BLANKETS AND TEMPORARY OR PERMINANT SEEDING SEE MNDOT SPEC 2885 AND 2575.
8. SWALES SHALL HAVE BLANKET COVERING FINAL 200'.
9. SWALES SHALL HAVE CHECK DAMS IF SLOPE IS GREATER THAN 3:1.
10. ALL INSTALLED SEDIMENT AND EROSION CONTROL PRACTICES MUST BE MAINTAINED FOR THE DURATION OF THE PROJECT.

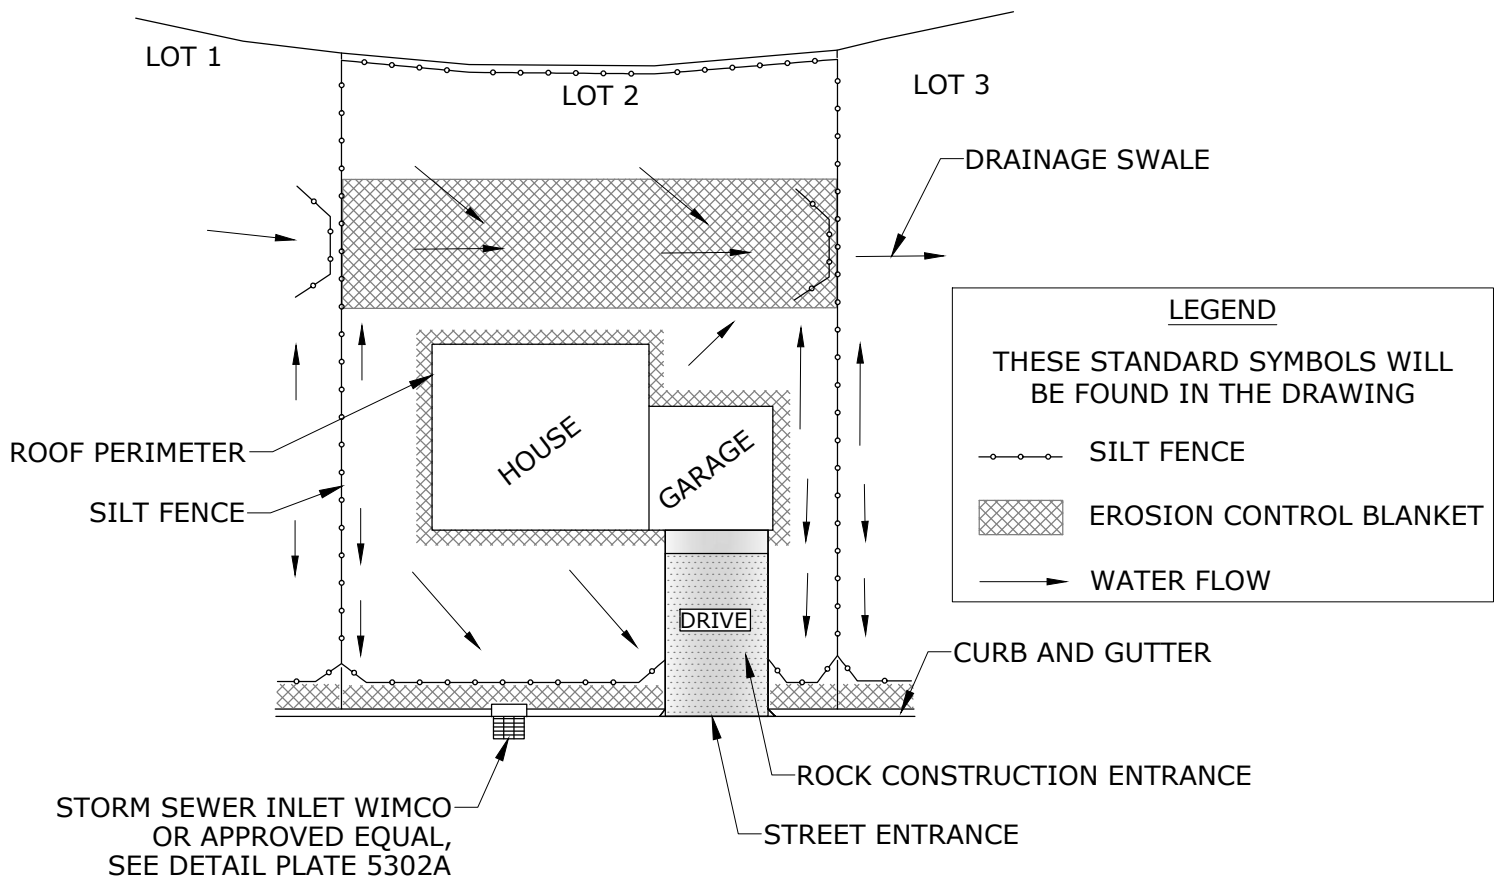

EROSION CONTROL FOR INDIVIDUAL LOT WITH SWALE DRAINAGE

REVISED: 2-24

ENGINEERING DEPARTMENT

PLATE NO.:

5302C