



SOFT CONNECTION

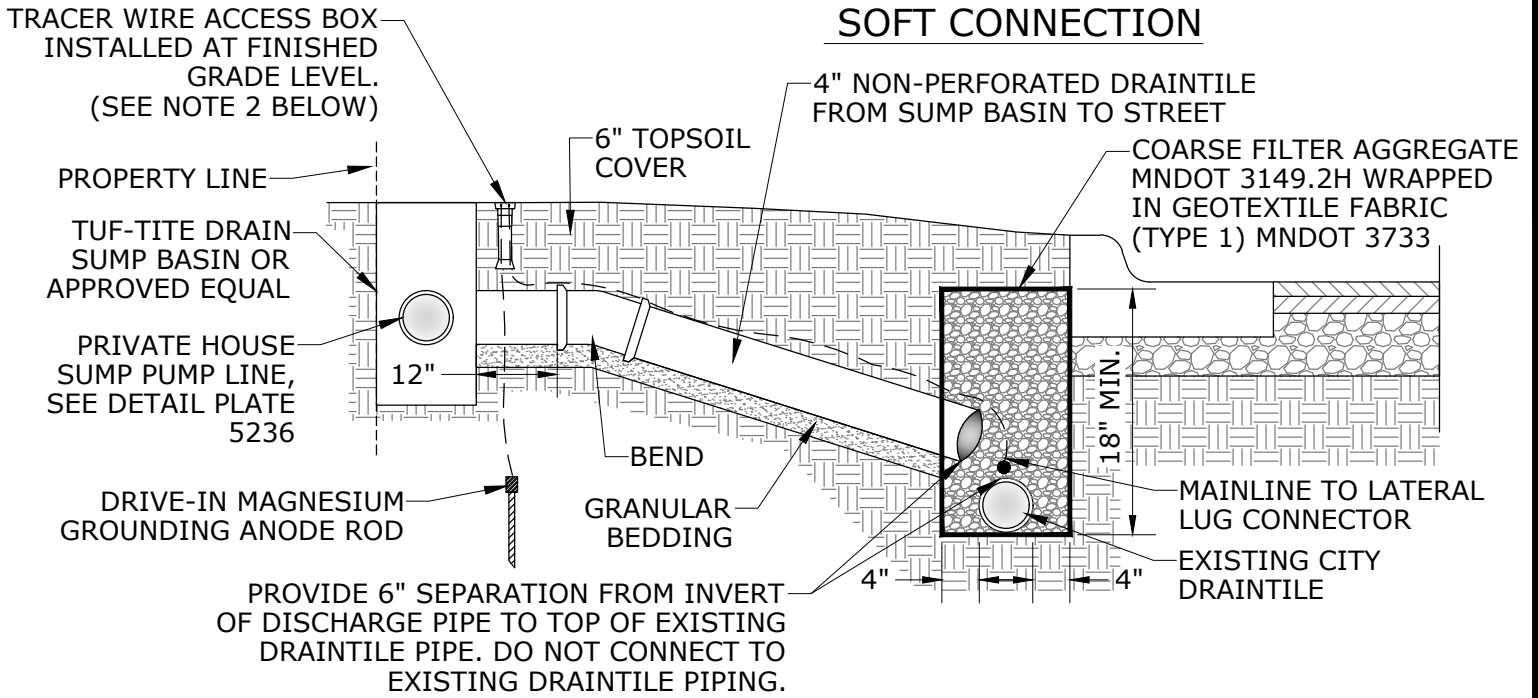


HARD CONNECTION

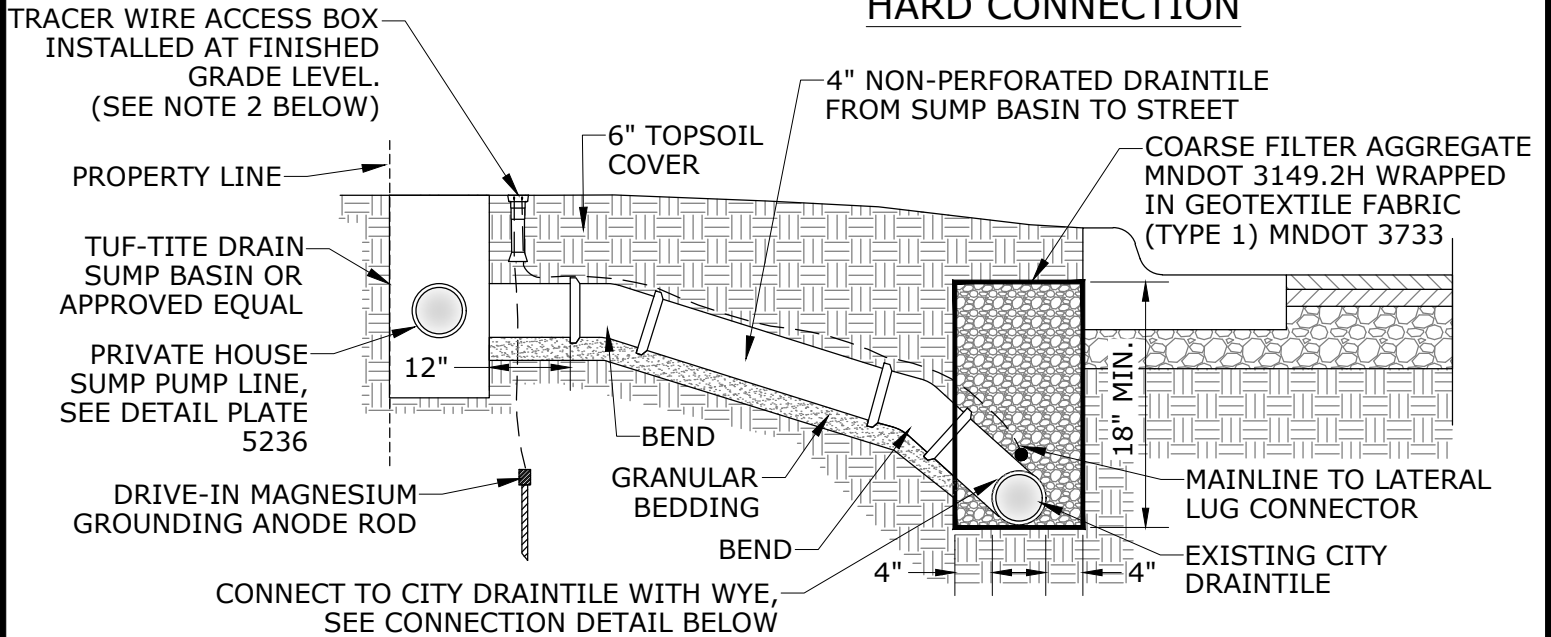

NOTES:

1. PRIVATE DRAIN CONNECTIONS SHALL BE FOR SUMP DISCHARGE ONLY. NO OTHER DRAINTILE, DOWNSPOUT CONNECTIONS, ETC. ARE ALLOWED.
2. INSTALL TRACER WIRE SYSTEM PER SPEC'S AND DETAIL PLATE 5507.

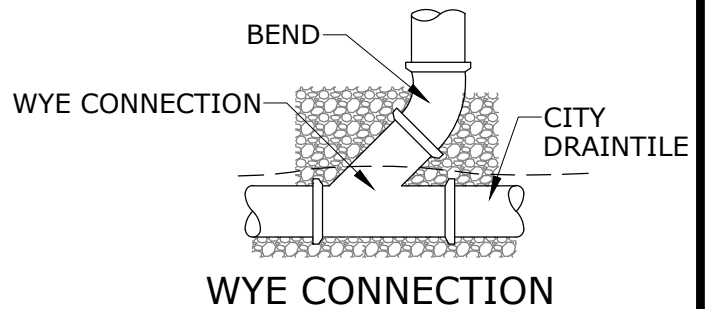

TYPICAL SUMP PUMP DISCHARGE CONNECTION



REVISED: 2-24

ENGINEERING DEPARTMENT

PLATE NO.:

5235