


Job No. 2022-11-10
City of Chantassen 2022-11-10
G:\Projects\2022\11-10\Drawings\Permit\0507\0507-04.dwg

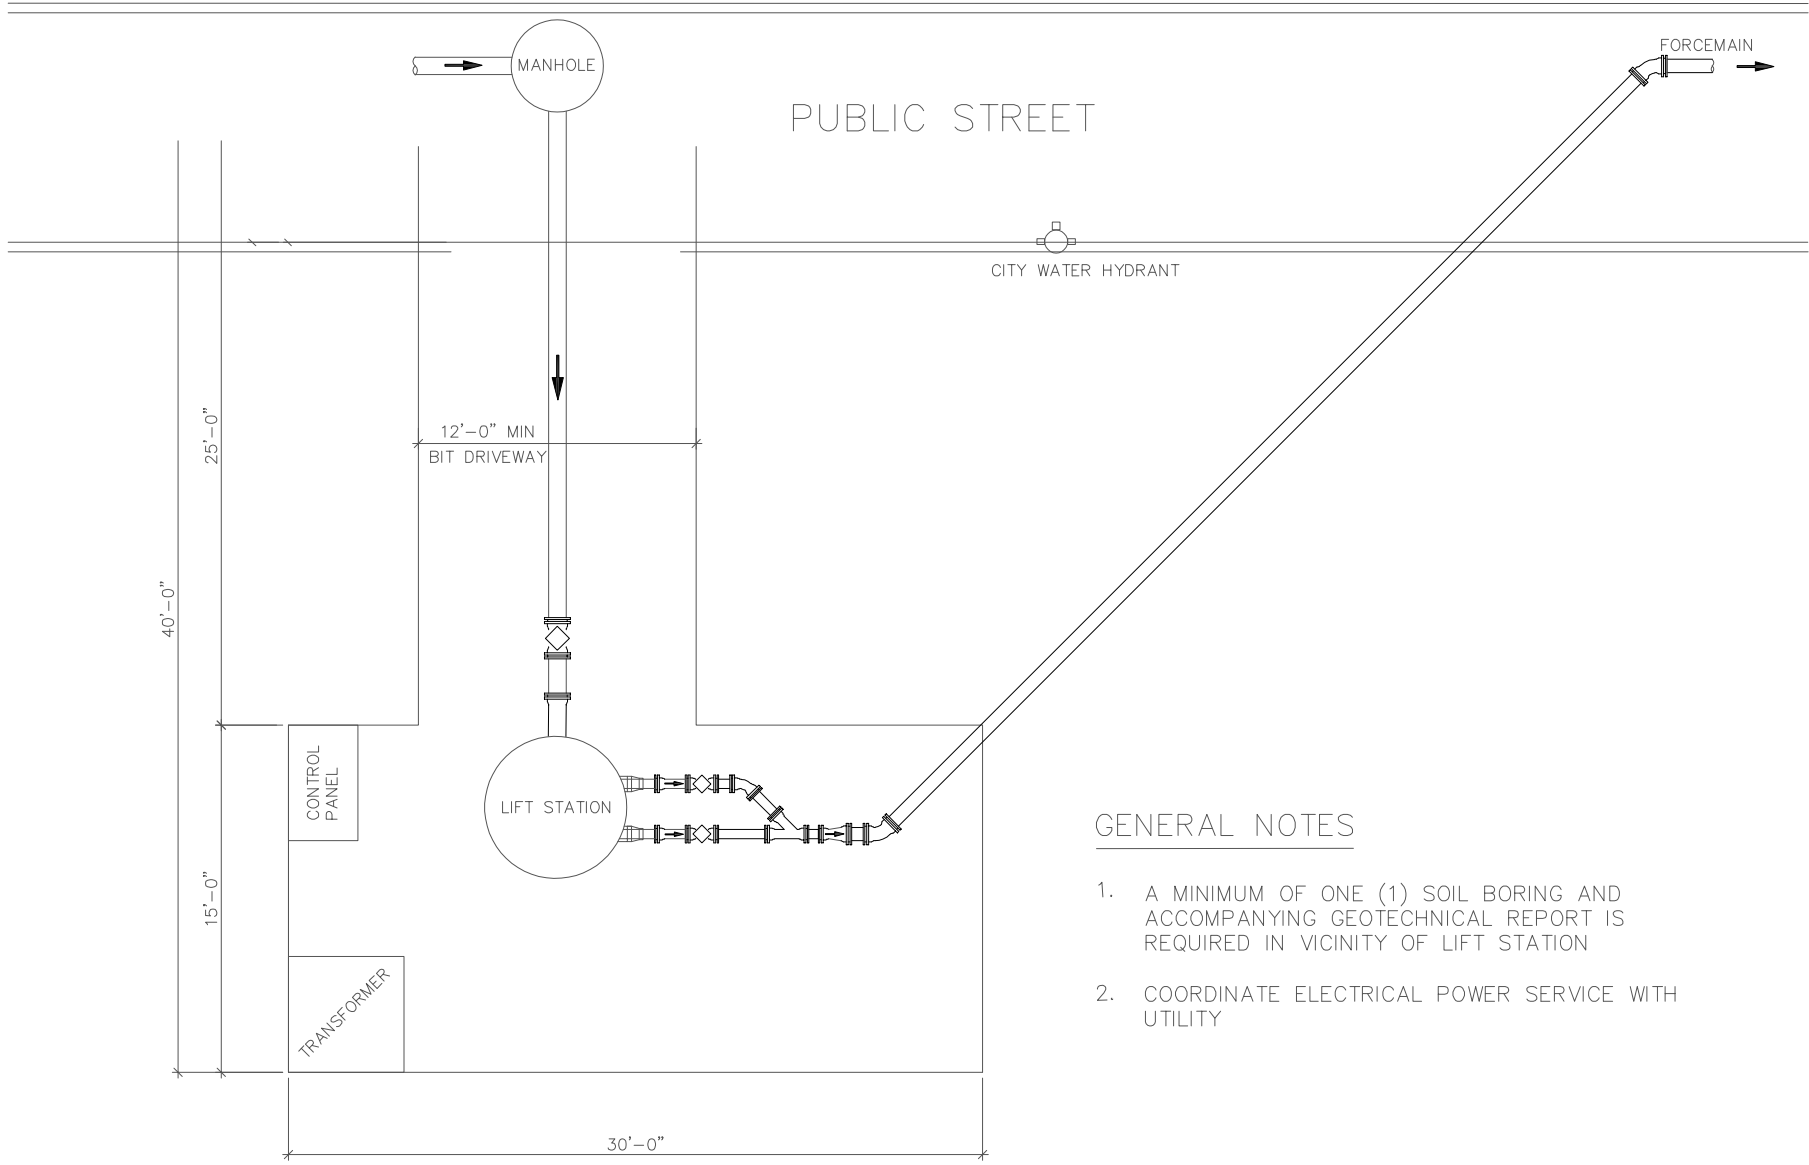

PUBLIC STREET

CITY WATER HYDRANT

FORCEMAIN

MANHOLE

LIFT STATION

CONTROL PANEL

TRANSFORMER

12'-0" MIN
BIT DRIVEWAY

40'-0"

25'-0"


15'-0"

30'-0"

NTS

GENERAL NOTES

1. A MINIMUM OF ONE (1) SOIL BORING AND ACCOMPANYING GEOTECHNICAL REPORT IS REQUIRED IN VICINITY OF LIFT STATION
2. COORDINATE ELECTRICAL POWER SERVICE WITH UTILITY

FILE NAME: G:\ENG\SPCCS\5401C
ENGINEERING DEPARTMENT
REVISED: 1-22
PLATE: 5401-C
LIFT STATION SITE DETAIL
 CITY OF CHANTASSEN